

Evaluation of STATCOM's Control Method

ASHU RANI, SATISH K SHARMA, AMARJIT NATH

AbstractThe ever-increasing complexity of today's electric power systems is causing a great deal of trouble. Uncertainty in the electrical grid has recently been one of the most talked-about issues. Flexible AC Transmission Systems (FACTS) was a concept developed by the Electric Power Research Institute (EPRI) in the late 1980s as a solution to the issue of transient stability in power system design and operation. To address voltage instability, STATCOM is a novel FACTS device. Enhancing transmission line performance is the suggested usage of a 9-level Cascaded Multilevel Inverter (CMLI) as a STATCOM in this article. This study focuses on a single machine that is linked to a bus. A method of selective harmonic removal is suggested for lowering the THD.

Keywords: total harmonic distortion, modulation index, cascaded multilevel inverters, static synchronous compensators

distortion, harmonic removal with selective application

Introduction

Power is being transmitted through transmission line and they are interconnected due to economical reasons. There are mainly three type of transmission line 1) short transmission line 2) medium transmission line 3) long transmission line. There are various limits on these transmission line, these are thermal limit, voltage limit, stability limit. Thermal limit is mainly for short transmission line. Voltage and stability limit is for long transmission line. Voltage profile of a line depend upon the SIL (surge impedance loading) of the line. Voltage will sag if loading is more than SIL. So to improve the voltage profile we have supply additional reactive power. So we can use capacitor bank near the load end but this is not good. So we use FACTS (flexible alternating current transmission system) devices to improve the transmission line voltage profile. STATCOM is one of the important FACTS device. The main component of STATCOM is Voltage

Source Inverter (VSI) [1]. This voltage source inverter may be multi pulse or multilevel. But multilevel inverter has many advantages as compare to multi pulse inverter. As compare to multi pulse inverter, a multilevel inverter produces the desired output voltage by synthesis of several levels of input dc voltages. A nearly sinusoidal fundamental frequency output voltage of high magnitude can be produced by connecting sufficient number of input dc levels. Various type of multilevel inverters are reported in the literature. Diode clamped multilevel inverter (DCMLI), flying capacitors multilevel inverter (FCMLI), and cascade multilevel inverter (CMLI). But CMLI is most suitable for power system application. We can use CMLI in power system for reactive power compensation. [2]


Cascaded Multilevel Inverter

Cascaded multilevel inverter (CMLI) consists of a series of H-bridges inverter units. This inverter unit is single, phase full bridge. The main function of this multilevel inverter is to synthesize a desired voltage from several separate dc sources (SDCSs), which may be obtained from batteries, fuel cells or solar cells. Each SDCS is connected to an H-bridge inverter. The cascaded multilevel inverter does not require any voltage clamping diodes or voltage balancing capacitors. [2]

Principle of Operation

Fig shows the synthesized phase voltage waveform of a nine level cascaded inverter with four SDCSs. The voltage is synthesized by the sum of four inverter outputs. $v_{an} = v_{a1} + v_{a2} + v_{a3} + v_{a4}$. Each inverter level can generate three different voltage outputs +Vdc, 0, -Vdc, by connecting the dc source, to the ac output side by different combination of four switches S1, S2, S3, S4. By turning on S1 and S4 we get +Vdc Turning on S2 and S3 results -Vdc. when any two switches of same leg is on then voltage will be 0. In same manner voltage of other level can be obtained. [3-4].

If N_s is the number of DC sources, the output voltage Level $m = 2N_s + 1$ eg. A nine level cascaded inverter needs four SDCs and four full bridges. Controlling the conducting angles at different inverter levels can minimize the harmonic distortion of the output voltage. [5]

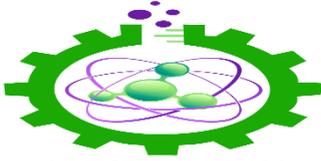

Hence we can say that Cascade multilevel inverter consists of number of H-bridges inverter units having isolated dc source for each unit and are connected in series. Three voltage levels i.e. $+V_{dc}$, 0, and $-V_{dc}$ (V_{dc} is input dc voltage) are produced by proper switching of devices of each H-bridge. The synthesized output voltage waveform is the sum of all of the individual H-bridge's outputs. Nearly sinusoidal output voltage waveforms can be synthesized by using sufficient number of H-bridges in cascade and choosing proper switching angles.[6]

An 9-level cascade multilevel inverter based STATCOM is used in this work. Let the switching angles corresponding to H-bridges H1, H2, H3 and H4 are α_1 , α_2 , α_3 and α_4 respectively. The ac output phase voltage magnitude is given by $v_{an} = v_{a1} + v_{a2} + v_{a3} + v_{a4}$. The switching angles $\alpha_1 \dots \alpha_4$, need to be selected properly as the harmonic distortion in the STATCOM output voltage depends very much on these angles. In the present work, these angles have been chosen in such a way that the harmonic distortion upto 49th order given by eqn. (1) is least

$$THD_{49} = \frac{\sqrt{V_5^2 + V_7^2 + \dots + V_{49}^2}}{V_1} \times 100 \quad (1)$$

In eqn. (1), V_n , is magnitude of nth harmonic voltage component where $n = 1, 5, 7, 11, 13 \dots 49$ to find out the angles we use selective harmonic elimination technique.[7]

Circuit Diagram


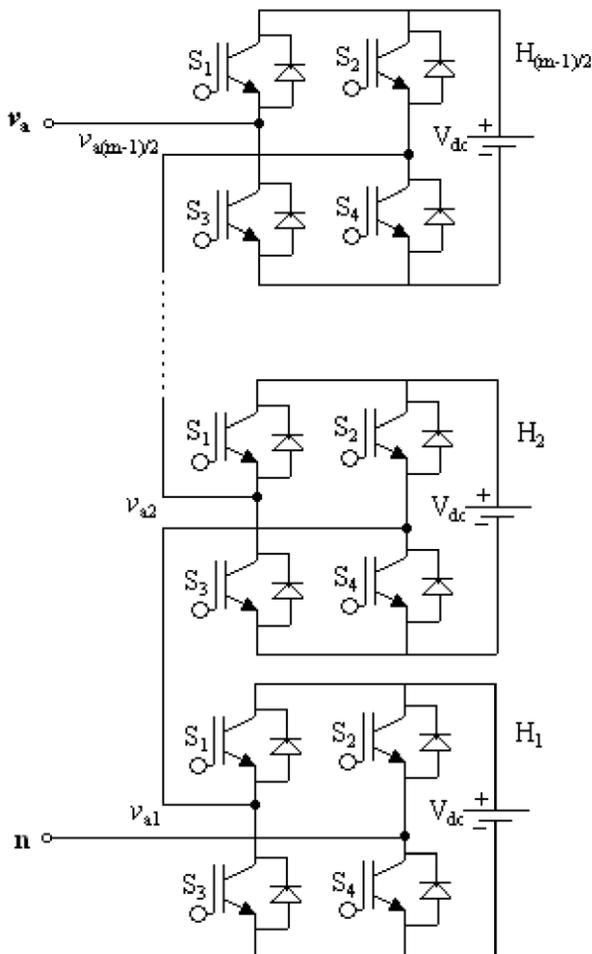


Figure 1: Single-phase cascade multilevel inverter topology.

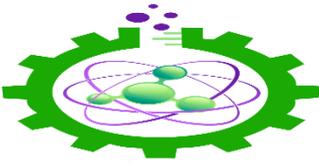

The magnitude of the ac output phase voltage is the sum of the voltages produced by H-bridges. In the Fig. 2, α_1 , α_2 and α_3 are the switching angles for three H-bridges in each phase, and β_1 , β_2 and β_3 are corresponding supplementary angles for α_1 , α_2 and α_3 . The magnitude and THD content of output voltage depends very much on these switching angles, therefore, these angles need to be selected properly. [8]

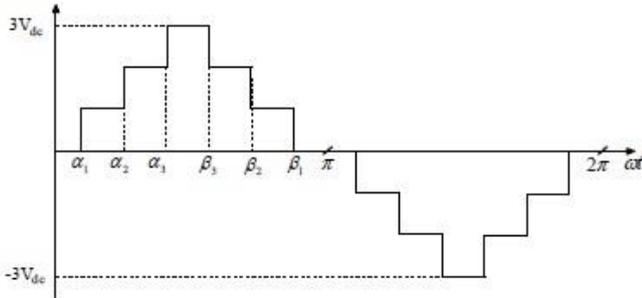


Figure 2: Output Phase Voltage Waveform for 7-Level CMLI

Selective Harmonic Elimination Technique

There are various PWM technique to control the voltage profile of VSI

1. Sinusoidal PWM 2.Third Harmonic injected PWM 3.Harmonic elimination PWM technique 4.Space vector Modulation. But in this work we have used Selective harmonic elimination technique.[8-9]

In general, the Fourier series expansion of the staircase output voltage waveform as shown in Fig. 2 is given by


$$v_{an}(\omega t) = \sum_{k=1,3,5,\dots}^{\infty} \frac{4V_{dc}}{k\pi} (\cos(k\alpha_1) + \cos(k\alpha_2) + \dots + \cos(k\alpha_s)) \sin(k\omega t) \quad (2)$$

Where s is the number of H-bridges connected in cascade per phase and k is order of harmonic components. For a given desired fundamental peak voltage V_1 , it is required to determine the switching angles such that $0 \leq \alpha_1 < \alpha_2 \dots < \alpha_s \leq \pi/2$ and some predominant lower order harmonics of phase voltage are zero. Among s number of switching angles, generally one switching angle is used for fundamental voltage selection and the remaining $(s-1)$ switching angles are used to eliminate certain predominating lower order harmonics. In three-phase power system, triplen harmonic components are absent in line-to-line voltage, as a result, only non-triplen odd harmonic components are present in line-to-line voltages the expression for the fundamental voltage in terms of switching angles is given by

$$\frac{4V_{dc}}{\pi} (\cos(\alpha_1) + \cos(\alpha_2) + \dots + \cos(\alpha_s)) = V_1$$

Moreover, the relation between the fundamental voltage and the maximum obtainable voltage is given by modulation index. The modulation index, m , is defined as the ratio of the fundamental output voltage (V_1) to the maximum obtainable fundamental voltage. The maximum fundamental voltage is obtained when all the switching angles are zero i.e. $V_{1max} = 4sV_{dc}/\pi$, therefore, $m = \pi V_1/4sV_d$.[10]

STATCOM Operation

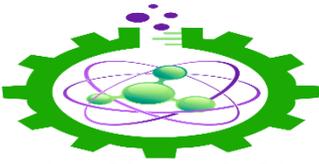

Basic Operating Principle

It is a combination of self-commutating solid-state turn-off devices (viz. GTO, IGBT, IGCT and so on) with a reverse diode connected in parallel to them. The solid-state switches are operated either in square-wave mode with switching once per cycle or in PWM mode employing high switching frequencies in a cycle of operation or selective harmonic elimination modulation employing low switching frequencies. A DC voltage source on the input side of VSC, which is generally achieved by a DC capacitor and output, is a multisteped AC voltage waveform, almost a sinusoidal waveform. The turn-off device makes the converter action, whereas diode handles rectifier action. STATCOM is essentially consisting of six-pulse VSC units, DC side of which is connected to a DC capacitor to be used as an energy storage device, interfacing magnetic (main coupling transformer and/or inter-mediate/inter-phase transformers) that form the electrical coupling between converter AC output voltage (V_c) and system voltage (V_s) and a controller. The primary objective of STATCOM is to obtain almost harmonic neutralized and controllable three-phase AC output voltage waveforms at the point of common coupling (PCC) to regulate reactive current flow by generation and absorption of controllable reactive power by the solid-state switching algorithm. As STATCOM has inherent characteristics for real power exchange with a support of proper energy storage system, operation of such controller is possible in all four quadrants of Q-P plane and it is governed by the following power flow.

$$S = 3 \frac{V_s V_c}{X_L} \sin \alpha - j3 \left(\frac{V_s V_c}{X_L} \cos \alpha - \frac{V_s^2}{X_L} \right) = P - jQ \quad (1)$$

where S is the apparent power flow, P the active power flow, Q the reactive power flow, V_s the main AC phase voltage to neutral (rms), V_c the STATCOM fundamental output AC phase voltage (rms), X the leakage reactance, L the leakage inductance, f the system frequency and α the phase angle between V_s and V_c .

Active power flow is influenced by the variation of α and reactive power flow is greatly varied with the magnitude of the voltage variation between V_c and V_s . Q is derived from (1) as follows:

$$S = 3 \frac{V_s V_c}{X_L} \sin \alpha - j3 \left(\frac{V_s V_c}{X_L} \cos \alpha - \frac{V_s^2}{X_L} \right) = P - jQ \quad (3)$$

Converter fundamental phase terminal voltage (rms) =

$$Q = \frac{V_s}{X_L} (V_c - V_s) \quad (4)$$

nth harmonic voltage(rms) =

$$V_{c_n} = V_{c_1} = \frac{\sqrt{2}}{\pi} V_{dc} \quad (5)$$

Converter fundamental reactive current(rms)=

$$I_{q_1} = \frac{V_s - V_c}{j\omega L} \quad (6)$$

STATCOMs are typically applied in long distance transmission systems, power substations and heavy industries where voltage stability is the primary concern.

In addition, static synchronous compensators are installed in select points in the power system to perform the following:

- Voltage support and control
- Voltage fluctuation and flicker mitigation
- Unsymmetrical load balancing iv. Power factor correction
- Active harmonics cancellation
- Improve transient stability of the power system



We can simply understand the working of STATCOM by Fig. 3. The voltage difference between the STATCOM output voltage (V_c) and the power system bus voltage (V_l) decides reactive power injection or absorption to the system. This voltage difference can be achieved by two different ways: either by changing the modulation index (m) at constant dc link voltage (v_{dc}) (direct control) or by varying v_{dc} at fixed m (indirect control) [11]. In indirect control, variation of v_{dc} is achieved by phase shifting v_c with respect to v_l . In direct control scheme, reactive power compensation is fast but harmonics level in v_c may vary according to the switching angles selected. On the other hand, indirect control is slow in operation but harmonic level of v_c can be kept least by proper selection of switching angles.[5]. Many VSC-based topologies and configurations are adopted in the state-of-the-art STATCOM controllers and significantly, multi-pulse and/or multi-level topologies are widely accepted in the design of compensators. An elementary six-pulse VSC which consists of three legs (phases) with two valves per leg and an electrostatic capacitor on the DC bus is illustrated in Fig. 1. Each valve consists of a self-commutating switch with a reverse diode connected in parallel. In square-wave mode, eight possible switching states are possible with respect to the polarity of DC voltage source. A set of three quasi square waveforms at its AC terminals, displaced successively by 120 degree, is obtained using fundamental frequency switching modulation. The phase to neutral and line-to-line voltage of the converter shown in Fig. 1 contain an unacceptable current harmonics causing severe harmonic interference to electrical system. To reduce THD, multi-pulse converter topology derived from the combination of multiple number (N numbers) of elementary six-pulse converter units to be triggered at specific displacement angle(s), is widely adopted, and output AC voltage waveforms from each unit is electromagnetically added with an appropriate phase shift by interphase transformer(s) to produce a multi-pulse ($6 * N$ pulses) waveform close to sinusoidal wave.

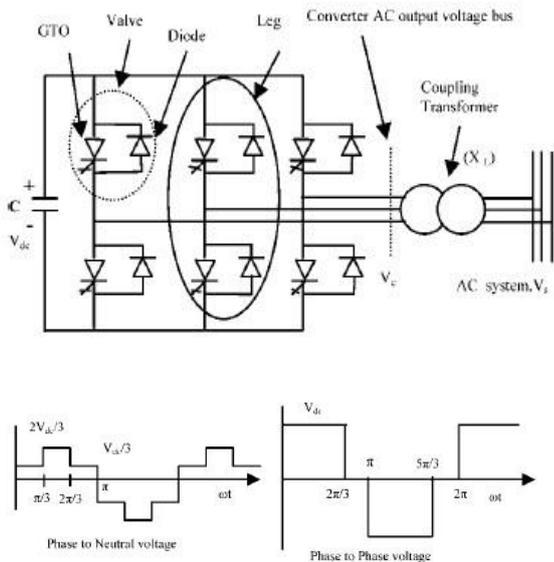


Figure 2: Basic two level six pulse VSC bridge and its output voltage waveform in square wave mode of operation


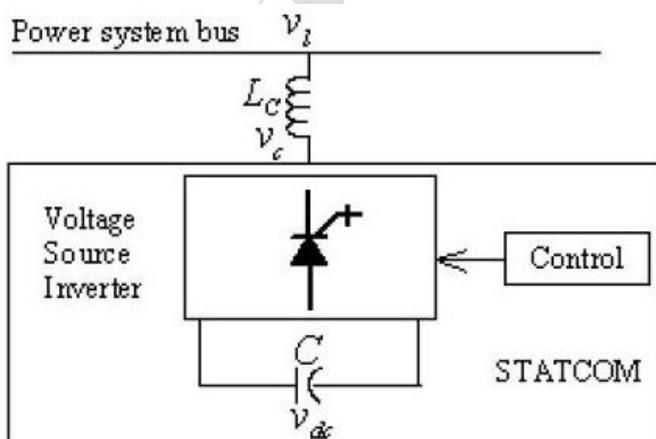


Figure 3: Basic Building Block for STATCOM

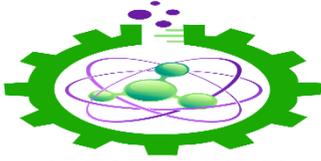

Controlling of STATCOM

If For proper working of statcom, proper voltage regulation we have to use proper control scheme for STATCOM. In this paper we are using cascaded multilevel inverter as a STATCOM. The output voltage generated by the cascade multilevel inverter needs to be varied smoothly and continuously so that the right amount of the reactive power can be exchanged with the ac system at all instants, therefore, an efficient control system is required. There are two type of controlling of STATCOM namely direct control and indirect control. In this paper we have carried out indirect controlling of STATCOM.

Indirect Control Scheme

Indirect control scheme the output voltage is controlled by varying the dc capacitor voltages at constant modulation index (i.e. at fixed switching angles). The indirect control scheme employed in this work is shown schematically in Fig. 4 for a CMLI having s number of H-bridges. As in direct control scheme, the switching angles for each H-bridge are calculated off-line and are stored in a look-up table. However, in this case, we can have fixed switching angles for a given value of m or if it is required to change m in that case we may have the look-up table.

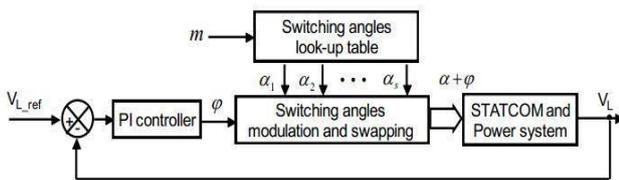


Figure 4: Schematic diagram of indirect control scheme for STATCOM

Simulation Results

Output load voltage waveform is as shown in fig 4. Here we can see that when at 0.1 sec load is increased voltage came down, and at 0.2 sec STATCOM is on and STATCOM improve the output voltage. STATCOM provide the necessary reactive power to system hence improve the load voltage.

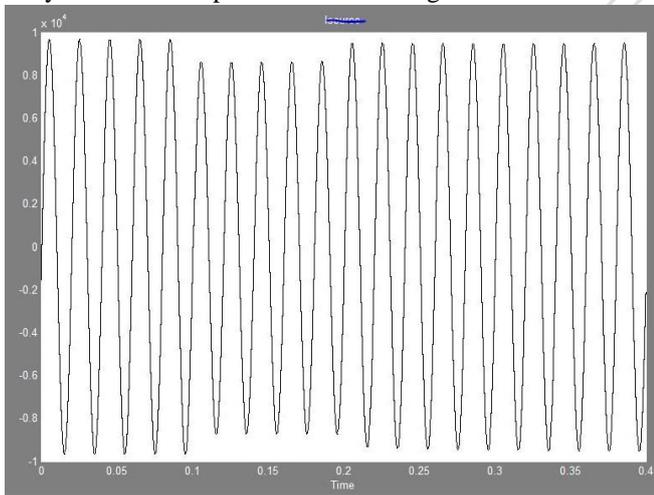


Figure 4: Output voltage at load bus

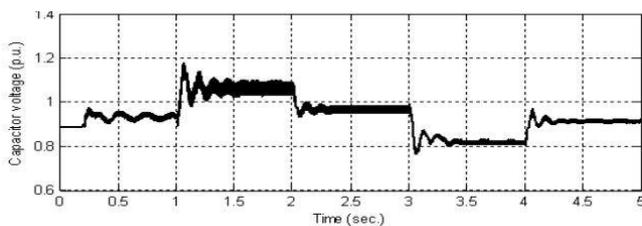


Figure 5: Capacitor Voltage (PU)

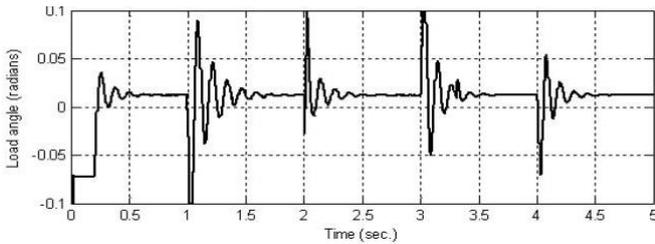
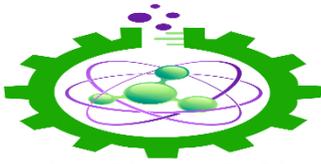


Figure 6: Load angle variation

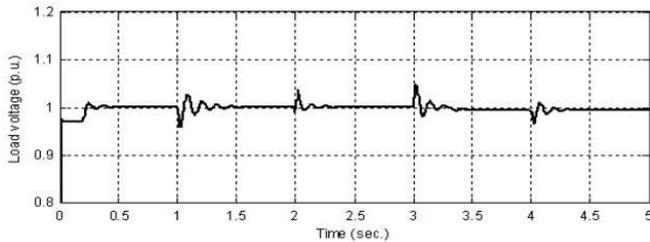



Figure 6: Output Load voltage variation in per-unit

Conclusion

As STATCOM is basically a voltage source inverter so we can use CMLI with capacitor with initial voltage V_{dc} as a STATCOM. To control the reactive power generation and absorption we use different control techniques reported in literature. Using cmlI we can get nearly a sine wave and can minimize distortion. As we increase in level different harmonics can be eliminated.

References

- Hingorani and Gyugi (2000): Flexible AC Transmission Systems: A Comprehensive Overview (Standard Publishers Distributors, pp. 135-206)
- Nasir H. Muhammad "Electronic circuits, devices, and applications" current version
- "Power electronics control in electrical system" by T.J. Miller is the latest volume in the Newnens Power Electronics series.
- Cascade Multilevel Inverters for Utility Applications, (1997) Peng, F. Z., McKeever, J. W., and Adams, D. J. IECON Proceedings, vol. 2, pp. 437-442.
- Paper 21023 from the 2011 International Conference on Power and Energy Systems (ICPS) at IIT Madras discusses the use of cascade multilevel inverters in a distribution system to indirectly control voltage. The authors are Jagdish Kumar, Biswarup Das, and Pramod Agarwal.
- The paper "Multilevel Optimal Modulation and Dynamic Control Strategies for STATCOMs Using Cascade Multilevel Inverters" was published in the IEEE Transaction on Power Delivery in 2007. It was written by Qiang Song, Wenhua Liu, and Zhichang Yuan.
- In Electric Power Components and Systems, volume 38, number 4, pages 445-464, Jagdish Kumar, Biswarup Das, and Pramod Agarwal provide an optimized switching scheme for a cascade multilevel inverter (2010).
- Static synchronous compensation: theory, modeling, and applications by Kalyan K. Sen
- Proceedings of the 9th Annual Applied Power Electronics Conference and Expo, February 13–17, 1994, "Control and simulation of static condenser" by K. R. Padiyar and A. L. Devi.
- In their 2007 July article for the IEEE Transaction on Power Delivery, Qiang Song, Wenhua Liu, and Zhichang Yuan discuss "Multilevel Optimal Modulation and Dynamic Control Strategies for STATCOMs Using Cascade Multilevel Inverters" (vol. 22, no. 3, pp. 1937-1946).
- Publication: July 1993, "Vector analysis and control of advanced static VAR compensators" by C. Schauder and H. Mehta, Proceedings of the Institution of Electrical Engineers, 140(4), pages 299–306,

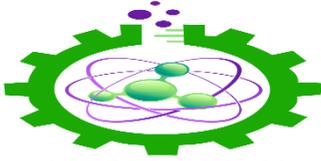

volume 140.

"Determination of the Best Location and Performance Analysis of STATCOM for Damping Oscillation" was published in April 2013 in the IEEE Trans. Power System by Gokhan Cakir, Ghadir Radman, and Kenan Hatipoglu. The article can be found on page 6 of the journal.

Sidhartha Panda, "Power system stability improvement using PSO: optimal location and controller design of STATCOM" publishing in June 2007 on SCIENCE DIRECT.

The authors of the 2005 article "Application of FACTS Devices for Damping of Power System Oscillations" are Rusejla Sadikovic, Petr Korba, and Goran Andersson. IEE Eastern Europe, Russia Online citation: 10.1109/PTC.2005.4524625

Year of Publication: 2005, Number of Pages: 1–6

Presented at the 2010 4th International Power Engineering and Optimization Conference (PEOCO), Asiye Aghazade's work is titled "Simultaneous Coordination of Power System Stabilizers and STATCOM in a Multi-machine Power System for Enhancing Dynamic Performance."

In 2010, the following pages were published: 13–18.

The article "Optimal Location Of TCSC Device For Damping Oscillations" was published in the ARPN Journal of Engineering and Applied Sciences in May 2009 and was written by Nuraddeen Magaji.

The article "Performance Evaluation of PSS and STATCOM on Oscillation Damping" was published in the International Journal of Engineering and Technology in February 2012 and was written by Ambafi, J. G., Nwohu, M. N., Ohize, H. O., and Tola, O. J.

Baker, M. H., Horwill, C., The 2001 Transmission and Distribution Conference and Exposition included the article "STATCOM Helps to Guarantee a Stable System." Volume 2 of the IEEE/PES The article's DOI is 10.1109/TDC.2001.971416. Volume 2, pages 1129–1132, published in 2001.

"Smart Energy Grid Engineering: A Novel Approach for Optimal Number and Location of FACTS Devices on IEEE-30 Bus Grid using Meta-Heuristic" (2013 IEEE International Conference on), by M. M. Eissa and T. S. Abdel-hameed, DOI: 10.1109/SEGE.2013.6707938. Publication Date: 2013, Number of Pages: 1–10

Lei Xianzhang, Lerch Edwin N., and Povh Dusan. Article published in August 2001 in the IEEE Transactions on Power Systems, titled "Optimization and Coordination of Damping Controls for Improving System Dynamic Performance,"

Optimal placement of transconductance coupled static capacitor (TCSC) device for oscillation damping, N. Magaji and M.W. Mustafa, ARPN Journal of Engineering and Applied Sciences, Vol. 4, No. 3, May 2009, pp. 28-34. Understanding FACTS: Concepts and Technology of Flexible AC Transmission Systems, L. Gyugyi, and N.G. Hingorani, in IEEE Press, New York, 2000.

Dear Sir/Madam, Proc. Gen. Trans. Distrib. 147 (2000) 218-222, IEE, Optimal placement of shunt FACTS devices in lengthy transmission lines.

Power System Analysis, by H. Saadat, published in 2002 by Tata McGraw-Hill in New Delhi.

An adaptive nonlinear coordinated excitation and STATCOM controller based on a Hamiltonian structure for enhancing the stability of multimachine power systems was presented at the IEE Proc. by Q.J. Liu, Y.Z. Sun, T.L. Shen, and Y.H. Song.